

Intertek

REPORT NUMBER: 101536541SAT-002A

ORIGINAL ISSUE DATE: March 13, 2014

REVISED DATE:

EVALUATION CENTER

Intertek Testing Services NA Inc.
16015 Shady Falls Road
Elmendorf, TX 78112

RENDERED TO

Fire Retardant Coatings of Texas, LLC
1150 Blue Mound RD West
#403
Haslet, TX 76052

Report of Testing "FX Fire Retardant Chemical" for compliance with the applicable requirements of the following criteria: ASTM E2768-11 TEST FOR EXTENDED DURATION SURFACE BURNING CHARACTERISTICS OF BUILDING MATERIALS (This standard uses the apparatus and procedure of test method ASTM E84 with the total test period extended to 30 minutes.)

TEST REPORT

ABSTRACT

Specimen I.D. "FX Fire Retardant Chemical"

Test Standard: ASTM E2768-11 TEST FOR EXTENDED DURATION
SURFACE BURNING CHARACTERISTICS OF BUILDING
MATERIALS

Test Date: March 11, 2014

Client: Fire Retardant Coatings of Texas, LLC

Test Results:

FLAME SPREAD INDEX* 15
SMOKE DEVELOPED INDEX* 130


MAXIMUM FLAME FRONT* 9.8 ft. Beyond Burners
Centerline

*Note: The *Flame Spread* and *Smoke Developed Index* are based on the initial 10 minutes of the test which represents the standard ASTM E84 test period. The *Maximum Flame Front* is based on the 30 minute test period and is measured from the centerline of the burners to a point where flame travel stops or up to a maximum of 24 feet.


Joseph Martinez
Technician III

March 13, 2014

Reviewed and approved:


Servando Romo
Project Manager

March 19, 2014

I. INTRODUCTION

This report describes the results of the ASTM E2768-11 TEST FOR EXTENDED DURATION SURFACE BURNING CHARACTERISTICS OF BUILDING MATERIALS a method for determining the comparative surface burning behavior of building materials, extended to a total of 30 minutes. This method uses the same equipment, apparatus, calibration of flame spread index and smoke develop index as test method ASTM E84. The flame spread index is calculated in accordance with ASTM E84 during the first 10 minutes and then extended by 20 minutes to a period of 30 minutes to determine the maximum flame travel from the burner centerline. This standard is based on a modification of Test Method E84 that has been used for many years in provisions in the building codes and related specifications pertaining to fire-retardant-treated wood. Such codes include the International Building Code (IBC) and International Residential Code (IRC) as well as other documents.

The purpose of the method is to determine the relative burning behavior of the material by observing the flame spread along the specimen for a period of 30 minutes. Flame spread and smoke density developed are reported, however, there is not necessarily a relationship between these two measurements.

"The use of supporting materials on the underside of the test specimen may lower the flame spread index from that which might be obtained if the specimen could be tested without such support... This method may not be appropriate for obtaining comparative surface burning behavior of some cellular plastic materials... Testing of materials that melt, drip, or delaminate to such a degree that the continuity of the flame front is destroyed, results in low flame spread indices that do not relate directly to indices obtained by testing materials that remain in place."

This standard should be used to measure and describe the properties of materials, products, or assemblies in response to heat and flame under controlled laboratory conditions and should not be used to describe or appraise the fire hazard or fire risk of materials, products, or assemblies under actual fire conditions. However, results of this test may be used as elements of a fire risk assessment which takes into account all of the factors which are pertinent to an assessment of the fire hazard of a particular end use.

II. PURPOSE

The ASTM E2768 test method is intended to compare the surface flame spread and smoke developed measurements to those obtained from tests of fiber cement board and select grade red oak flooring required by the ASTM E 84. The 30 minute performance characteristics in the conditions of classification are intended to be used in specific applications as required by building codes or other regulatory requirements or specifications. The test specimen surface (18 inches wide and 24 feet long) is exposed to a flaming fire exposure during the 30 minute test duration, while flame spread over its surface and density of the resulting smoke are measured and recorded. Test results are presented as the computed comparisons to the ASTM E 84 standard calibration materials.

III. TEST PROCEDURE

The tests were conducted in accordance with the procedures outlined in the American Society for Testing and Materials ASTM E84 except the test was continued for a total of 30 minutes. The self-supporting specimens were placed directly on the tunnel ledges. The *maximum flame front* is determined by adding 4.5 feet to the flame travel recorded by the *flame pointer* located on the exterior window side of the tunnel apparatus. The *flame pointer* starts recording flame travel at 4.5 feet from the burner centerline. The zero point for the *flame pointer* is 4.5 feet away from the burner centerline. The sample is exposed to 4.5 feet of flame and only propagation beyond 4.5 feet point is recorded by the *flame pointer*. The flame spread graph on page 10 represents the *flame pointer* position during the test and the *maximum FS (feet)* value on page 9 represents the *flame pointer* maximum recorded value. To determine the *maximum flame front*, 4.5 feet is added to the *maximum FS (feet)* value on page 9.

Example: If the *flame pointer* records a maximum flame distance of 5 feet then the *maximum flame front* from the burner centerline is 5 feet plus 4.5 feet. (9.5 feet)

As required by the standard, one or more layers of 0.25 inch thick reinforced concrete board are placed on top of the test sample between the sample and the tunnel lid. After the tests, the samples are removed from the tunnel, examined and disposed of.

IV. REVISION SUMMARY

DATE	SUMMARY
March 13, 2014	Original

V. DESCRIPTION OF TEST SPECIMENS

Date Received:	2/27/2014
Date placed in the conditioning room:	2/27/2014
Conditioning (73°F & 50% R.H.):	12 days
Specimen Width (in):	22
Specimen Length (ft):	24
Specimen Thickness (in):	1.52
Total Specimen Weight (lbs):	160

Specimen Description:

The specimen was described by the client as "Treated Lumber (SPF) with FX Fire Retardant Chemical covers the following species of wood: Fir Species (Doug, Hem & White), Pine Species (Yellow & Ponderosa), SPF, White Spruce, OSB, Oak and Cedar. Meets Applicable Codes, Ordinances and Requirements of IBC 2303".

The 24ft. long test specimen consisted of three 8ft. long wood decks with a coated side.

Mounting Method:

The specimen was self-supporting. The finished side was exposed towards the flames.

The product was received by our personnel in good condition and given an identification number of SAT1402271820-003.

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of the report. Only the Client is authorized to copy or distribute this report and then only in its entirety. Any use of Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

VI. TEST RESULTS & OBSERVATIONS

Test Specimen	10 Minute Flame Spread Index	30 Minute Maximum Flame Front
"FX Fire Retardant Chemical"	15	9.8

The data sheets are included in Appendix A. These sheets are actual print-outs of the computerized data system which monitors the tunnel furnace, and contain all calibration and specimen data needed to calculate the test results.

VII. OBSERVATIONS

During the test, the specimen was observed to behave in the following manner.

Time (min:sec)	Observations
0:00	The test burners were turned on.
0:41	The wood began to crack.
0:54	Steady ignition was observed.
2:47	The wood began to flake.
30:00	The test burners were shut off.

After the burners were turned off, a 60+ second after flame was observed.

After the test, the specimen was observed to be damaged as follows:

Distance (FEET)	Damage Descriptions
0 – 10	The wood was observed to be heavily charred and cracked.
10 – 15	The wood was observed to be charred.
15 – 17	The wood's surface was observed to be charred.
17 – 24	The wood's surface was observed to be lightly charred.

VIII. CONDITIONS OF CLASSIFICATION

The test method has the following conditions of classification for a material or product to be classified as meeting the requirements of this standard:

- a.) The flame spread index shall be 25 or less as determined for the initial 10 min test period.
- b.) The flame front shall not progress more than 10.5 ft (3.2 m) beyond the centerline of the burners at any time during the 30 min test period. This is considered evidence of no significant progressive combustion in this test method.

Test Results

Test Specimen	10 Minute Flame Spread Index	30 Minute Maximum Flame Front
"FX Fire Retardant Chemical"	15	9.8

IX. CONCLUSION

This specimen passed the ASTM E2768-11 requirements.

Appendix A
ASTM E2768-11
Data Sheets

TEST RESULTS

FLAMESPREAD INDEX: 15

SMOKE DEVELOPED INDEX: 130

SPECIMEN DATA . . .

Time to Ignition (sec): 54

Time to Max FS (sec): 583

Maximum FS (feet): 5.3

Time to 980 F (sec): Never Reached

Time to End of Tunnel (sec): Never Reached

Max Temperature (F): 671

Time to Max Temperature (sec): 1744

Total Fuel Burned (cubic feet): 133.03

FS*Time Area (ft*min): 27.4

Smoke Area (%A*min): 243.0


Unrounded FSI: 14.1

CALIBRATION DATA . . .


Time to Ignition of Last Red Oak (Sec): 55.0

Red Oak Smoke Area (%A*min): 76.9


FLAME SPREAD (ft)

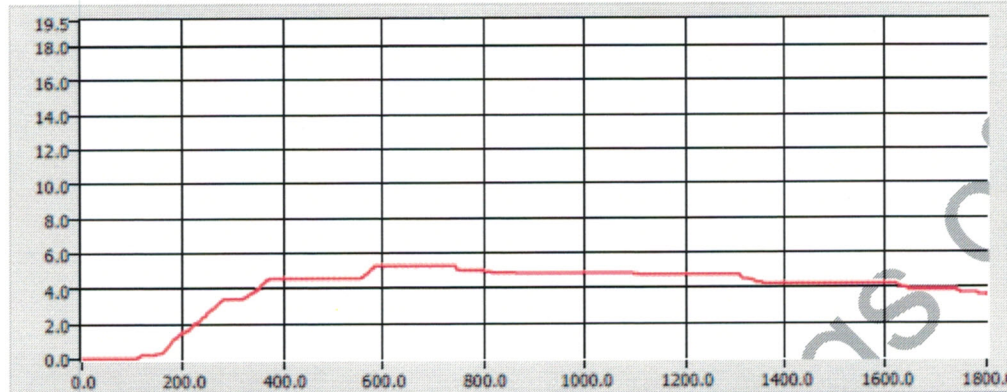

Smoke (%A)

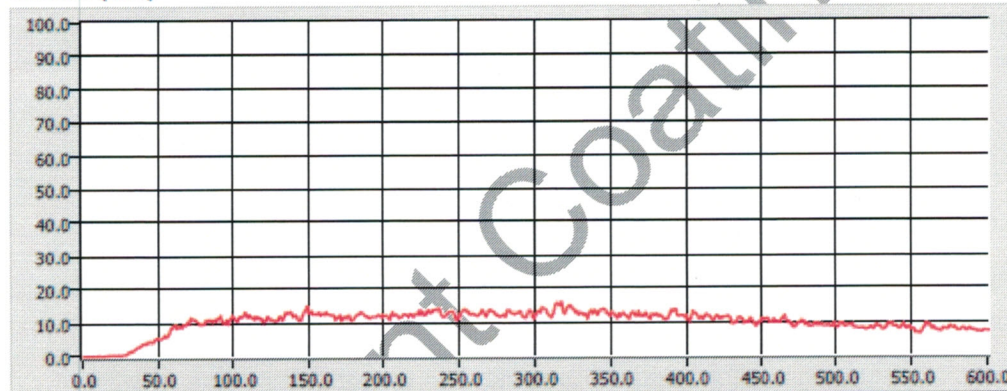

Temperature (°F)

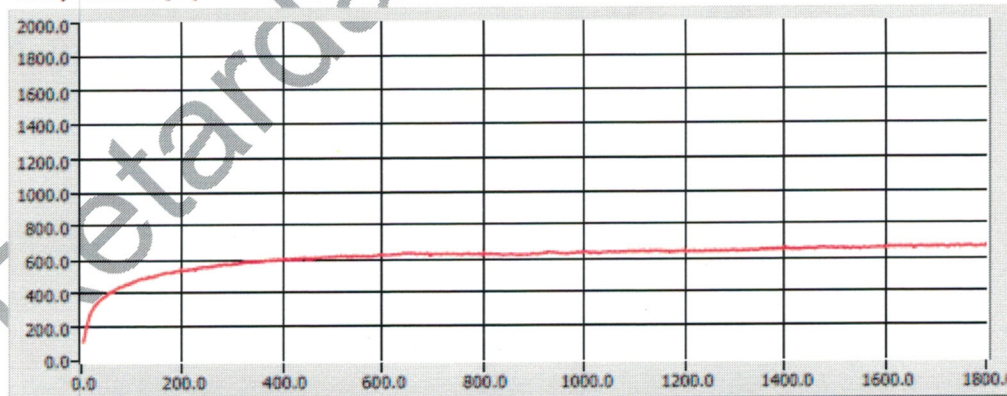

Time (sec)

600